




The iRelay 60-E is an advanced intelligent protection relay that integrates protection, control, measurement, supervision and automation functions into a single device. Housed in a compact 144x178x140.1mm casing, it features a backlit, intuitive LCD display for easy navigation, along with additional I/O options. Combining maximum reliability with exceptional functionality and flexibility, the iRelay 60-E is ideal for various applications in MV or HV Energy Distribution, including Feeders, Busbar, Transformers, Capacitor Bank and Motors.

Typical Applications

- Distribution Transformer Protection
- Capacitor Protection
- Busbar and Feeder Protection
- Motor Protection
- General-Purpose Backup Protection for other Power System Circuits or Devices

Functional Diagram

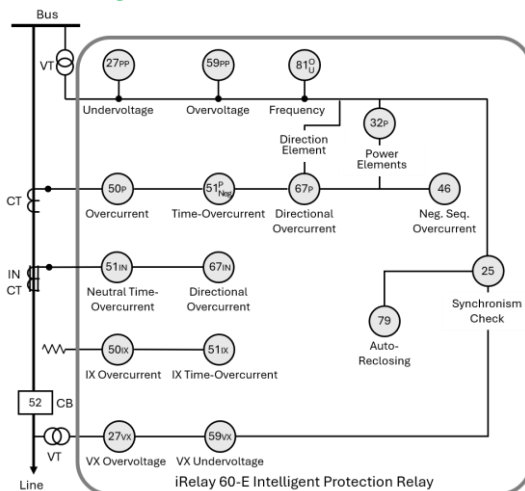

Basic Features

- Large, backlit LCD for data viewing, relay control, diagnostics and configuration
- LEDs for trip/alarm and breaker status indication and fault type
- 3xVoltage Input: VA, VB, VC
- 3xCurent Input: IA, IB and IC
- 1xNeutral Current Input (IN) for standard ground fault protection
- 1xAuxiliary Voltage Input (VX) for directional zero-sequence voltage input offering phase-to-ground insulation monitoring (59VL) or single phase voltage (phase-to-phase voltage) for synchronism check (25)
- 1xAuxiliary Current Input for sensitive Neutral Current Input (for example, Transformer/Capacitor Bank secondary side)
- 9xDigital Input externally excited @110/220VAC/DC
- 5xMechanical Relay Output (1xForm C, 4xForm A)
- 1xOptically isolated RS-485 port with Baud Rate from 2.4 to 38.4 kbps, supporting Modbus RTU protocol

Protection Functions

- Comprehensive protection functions with reliable performance and fast response
- Current Protection
 - Inrush Current Blocking Protection (50/68)
 - Switch On To Fault Protection (SOTF)
 - Phase Current Acceleration SOTF Protection (SOTF AR)
 - DI SOTF Protection (SOTF DI)
 - Phase Overcurrent Protection (67P-1)
 - Definite Time Overcurrent Protection (67P-2)
 - Definite Time Overcurrent Protection Stage I, II and III (67P-3, 67P-4, 67P-5)
 - Overload Protection (50P-6)
 - Inverse Time Overcurrent Protection (51P)
 - IN SOTF Protection (SOTF IN)
 - IN Acceleration SOTF Protection (SOTF IN AR)
 - IN Overcurrent Protection Stage I, II, III and IV (67IN-1, 67IN-2, 67IN-3, 67IN-4)
 - IN Inverse Time Overcurrent Protection (51IN)
 - IO SOTF Protection (SOTF IO)
 - IO Acceleration SOTF Protection (SOTF IO AR)
 - IO Overcurrent Protection Stage I, II and III (67IO-1, 67IO-2, 67IO-3)
 - IO Inverse Time Overcurrent Protection (51IO)
 - Negative Sequence Overcurrent Protection Stage I and II (46-1, 46-2)
 - IX Overcurrent Protection (50IX)
 - IX Inverse Time Overcurrent Protection (51IX)
- Voltage Protection
 - Overvoltage Protection Stage I and II (59PP-1, 59PP-2)
 - Undervoltage Protection Stage I and II (27PP-1, 27PP-2)
 - Undervoltage Splitting Protection (27Sp)
 - VX Overvoltage Protection Stage I and II (59VX-1, 59VX-2)
 - VX Undervoltage Protection Stage I and II (27VX-1, 27VX-2)
- Frequency and Power Protection
 - Overfrequency Protection Stage I and II (81O-1, 81O-2)
 - Underfrequency Protection Stage I and II (81U-1, 81U-2)
 - Directional Power Protection Stage I and II (32P-1, 32P-2)
- Motor Protection
 - Motor Status Monitoring (MSTOP, MSTART, MRUN)
 - Motor Start-up Protection (48)
 - Thermal Overload Protection (49)
 - tE Protection (tE)
 - Locked Rotor Protection (50LR)
 - Loss of Load Protection (37I)
 - Motor Restarting Function (267/62)
 - Starting Times Protection (66T)
- DI Protection and others
 - Digital Input Protection (IN3-T~IN10-T)
 - Synchronism Check (25)
 - Auto Reclosing (79)
 - Insulation Monitoring (NV)
 - Restart Inhibition (66INTVAL)
 - Loss of Potential (LOP)
 - CT Monitoring (CTS)
 - Trip Circuit Supervision (74TC)
- Basic protection elements
 - Low-voltage Element
 - Zero-sequence Voltage Element
 - Phase Current-direction Element
 - Neutral Current-direction Element

Metering and Monitoring

- Primary metering for Ua, Ub, Uc, Uab, Ubc, Uca, Aux. Voltage Ux, Ia, Ib, Ic, In, Aux. Current Ix, Frequency, Aux. Frequency, Per-phase and Total P, Q, S and PF
- Secondary metering for UA, UB, UC, UAB, UBC, UCA, Aux. Voltage UX, IA, IB, IC, IN, Aux. Current IX, Voltage Sequences U1/U2/U0, Current Sequences I1/I2/I0, UAB, Frequency, Aux. Frequency, P, Q, S, PF Total, Per-phase P and Q, Thermal Capacities in inverse-time protection
- Energy metering for kWh, kvarh Import/Export
- Voltage/Current Transformer circuit supervision
- Trip/Start or Open/Close circuit supervision requiring two Digital Inputs for each circuit breaker pole



Data and Event Recorders

Waveform Recorder

- 8 latest waveform logs of Current, DI/DO Status triggered by Protection Start/Operation/Return or manual trigger
- 8 cycles for pre-fault (2 cycles x 32 samples/cycle) and post-fault (6 cycles x 16 samples/cycle)
- Stored in non-volatile memory and retrievable through communications

SOE Log

- 256 FIFO time-stamped with characteristic value
- I/O Changes, Protection Logs, Power On/Off, Setup Changes, Time Sync., Device Operations and Self-diagnostics, etc.

Communications

- Optically isolated RS-485 port with Baud Rate from 2.4 to 38.4 kbps, supporting Modbus RTU protocol

Time Synchronization

- Battery-backed RTC @6ppm (error <0.5s/day)
- Time Sync. via RTC, Modbus RTU

System Integration

- The iRelay 60-E is supported by CET's PecStar® iEMS
- The iRelay 60-E can be easily integrated into other 3rd party systems because of its support of Modbus RTU protocol


Metering Accuracy

Parameters	Accuracy	Resolution
Voltage	±0.50%	0.01V
Current	±0.5%	0.001A
Frequency	±0.01Hz	0.001Hz
P, Q	±0.5%	0.001kX
PF	±1.0%	0.001
kWh	Class 1	1kWh
kvarh	Class 2	1kvarh


Protection Accuracy

Current Protection	
Pickup currents tolerance	2.5% of setting value or 0.01In
Trip time tolerance	
Instantaneous trip	40ms
Definite time trip	40ms or 1% of setting value
Inverse definite minimum time trip	40ms or 5% of reference (calculated) value + 2.5% current tolerance
Angle faults (directional faults)	±3°
Voltage Protection	
Pickup voltage tolerance	2.5% of setting value or 0.2V
Trip time tolerance	40ms or 1% of setting value
Frequency Protection	
Pickup frequency tolerance	0.01Hz
Trip time tolerance	40ms or 1% of setting value

Connection Diagram

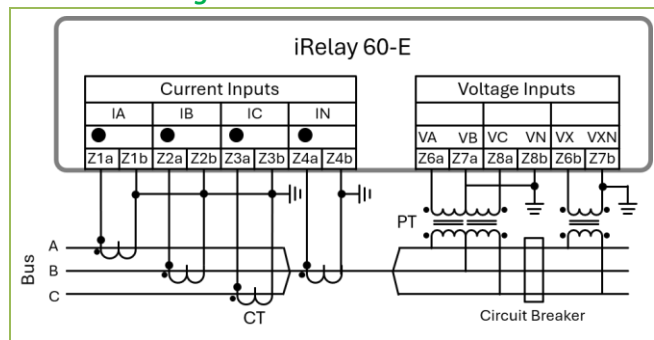

Terminals Diagram

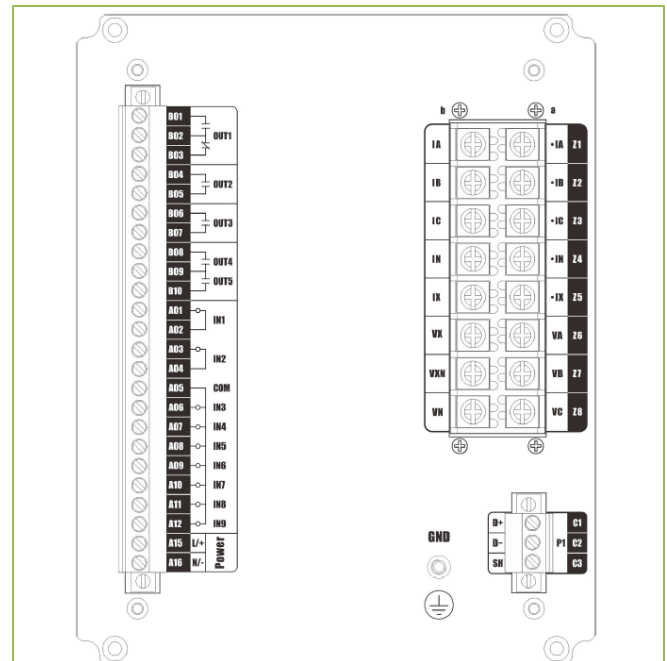

Index	Label	Description
B01-B10	OUT1-OUT5	Relay Outputs
A01-A12	IN1, IN2, COM, IN3-IN9	Digital Inputs
A15-A16	L/+, N/-	Power Supply
Z1a-Z5a	•IA, •IB, •IC, •IN, •IX	Current Inputs
Z1b-Z5b	IA, IB, IC, IN, IX	
Z6a-Z8a	VA, VB, VC	Voltage Inputs
Z6b-Z8b	VN, VX, VXN	
C1-C3	D+, D-, SH	RS-485 Port
	GND	Chassis Ground Input

Technical Specifications

Voltage Inputs (VA, VB, VC, VN, VX, VXN)	
Nominal (UN)	100 VAC (L-L)
Range	0.01-1.5UN (L-L)
Overload	1.4xUN continuous, 2xUN for 10s
Burden	< 0.5VA per phase
Frequency	50Hz/60Hz
Current Inputs (•IA, IA, •IB, IB, •IC, IC, •IX, IX)	
Nominal (IN)	5A or 1A
Metering Range	0.02-1.2IN
Protection Pickup Range	0.04-20IN
Overload	2xIN continuous, 10xIN for 10s
	50xIN for 1s
Burden	<1VA per phase (5A Input) <0.5VA per phase (1A Input)
Neutral Current Input (•IN, IN)	
Nominal	1A
Metering Range	0.04A-20A
Power Supply (L/+, N/-)	
Standard	88-264 VAC/DC, 50/60Hz
Burden	<5W
Digital Inputs (IN1-IN9, COM)	
Voltage	110VAC/DC, 220VAC/DC
Hysteresis	1ms minimum
Digital Outputs (OUT1-OUT5)	
Quantity	
OUT1	Form C
OUT2-OUT5	Form A
Rated Voltage	250VAC/24VDC
Continuous Contact Carry	8A
Max. Switching Power	2000VA/192W
Min. Switching Load	100mA @ 5VDC
Operate Time	<10ms
Release Time	<5ms




Standards of Compliance

Safety Requirements	
CE LVD 2014/35/EU	EN 61010-1: 2010 + A1: 2019 EN IEC 61010-2-030: 2021 + A11: 2021
Electrical Safety in Low Voltage Distribution Systems up to 1000Vac and 1500 Vdc	IEC 61557-12: 2021 (PMD)
Products Safety Requirements and Tests	EN 61010-1: 2010 + A1: 2019
AC Voltage	2kV @ 1 minute
Insulation Resistance	>100MΩ
Impulse Voltage	5kV, 1.2/50μs
Electromagnetic Compatibility EMC 2014/30/EU (EN IEC 61326: 2021)	
Electrostatic Discharge	EN 61000-4-2: 2009
Radiated Fields	EN IEC 61000-4-3: 2020
Fast Transients	EN 61000-4-4: 2012
Surges	EN 61000-4-5: 2014 + A1: 2017
Conducted Disturbances	EN 61000-4-6: 2023
Magnetic Fields	EN 61000-4-8: 2010
Impulse Magnetic Fields	EN 61000-4-9: 2016
Voltage Dips & Interruptions	EN IEC 61000-4-11: 2020
Ring Wave	EN 61000-4-12: 2017
Ripple on DC Input Power Port	EN 61000-4-17: 2019
Damped Oscillatory Wave	EN IEC 61000-4-18: 2019
Mechanical Tests	
Vibration Test	IEC 60255-21-1
Shock Test	IEC 60255-21-2
Seismic Test	IEC 60255-21-3

Ordering Information

Version 20251023	
Product Code	Description
iRelay 60-E Intelligent Protection Relay	
Basic Function	
• Rated VLL Nominal Input: 100VAC, 150VAC Max.	
• Protection Categories: Feeder, Transformer, Motor, Capacitor, Busbar	
• Hardware Spec: 32-bit CPU with 12-bit A/D, Metal Enclosure, 9xDI, 5xDO, 1xRS-485	
• Protocols: Modbus RTU	
• Features: Waveform Recording, SOE, Motor Starting Log	
Language	
E	English
Ip (Phase Current)	
5	5A
1	1A
IN (Neutral Current)	
1	0.04A-20A
IX (Auxiliary Current)	
5	5A
1	1A
Power Supply, DI Excitation	
2	220V DC/AC
1	110V DC/AC
System Frequency	
5	50Hz
6	60Hz
I/O	
B	9xDI + 5xDO
Communication Ports	
A	1xRS-485 Port
iRelay 60-E - E 5 1 5 2 5 B A	iRelay 60-E-E51525BA (Standard Model)

Dimensions and Installation

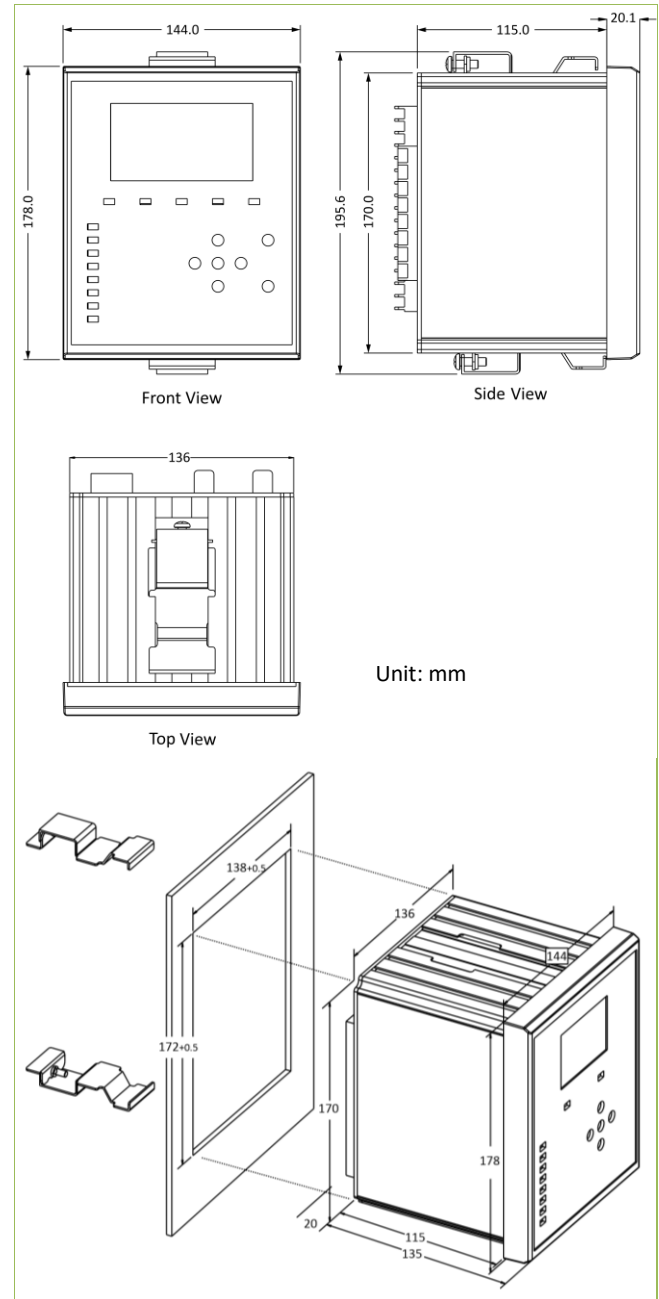

Your Local Representative

CET Electric Technology Inc.

E: sales@cet-global.com

W: www.cet-global.com

Revision Date: December 29, 2025

Designed For Reliability

Manufactured To Last